




**SEWER MAIN PARALLEL TO WATER MAIN OR WATER SERVICE LATERAL (TYP)**

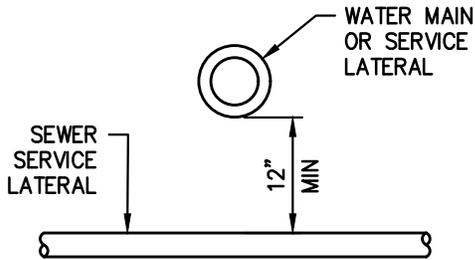


**SEWER SERVICE LATERAL CROSSING WATER MAIN OR WATER SERVICE LATERAL (TYP)**

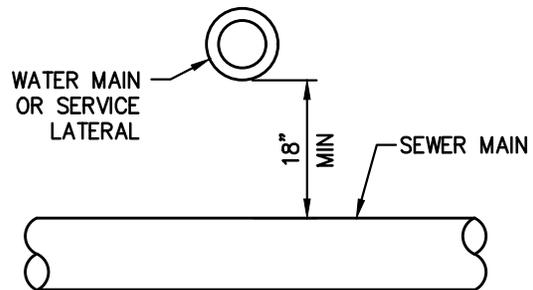

**SEWER MAIN CROSSING WATER MAIN OR WATER SERVICE LATERAL (TYP)**

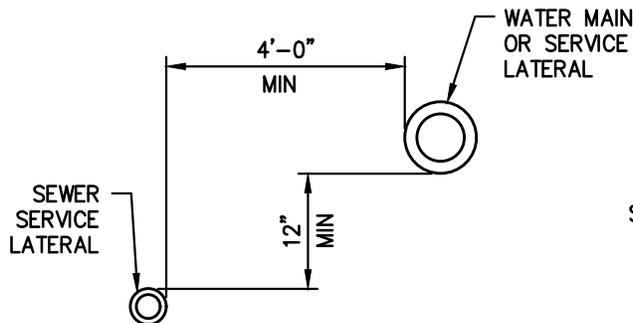

**SEWER SERVICE LATERAL PARALLEL TO WATER MAIN OR WATER SERVICE LATERAL (TYP)**

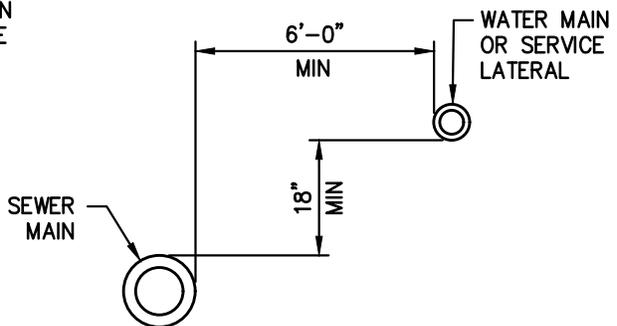

**SEWER MAIN PARALLEL TO WATER MAIN OR WATER SERVICE LATERAL (ALT)**

**NOTES:**

1. INSTALLATION OF WATER, SEWER AND STORM DRAIN MAINS AND LATERALS SHALL BE IN CONFORMANCE WITH NAC 445A.67155 TO NAC 445A.6718 FOR WATER AND SEWER SEPARATION AND CROSSING REQUIREMENTS.
2. SEWER LINES AND WATER LINES SHALL BE INSTALLED IN SEPARATE TRENCHES IN THE TYPICAL CONFIGURATIONS SHOWN ABOVE. IF COMPLIANCE WITH THE REQUIREMENTS IS NOT PRACTICABLE, THE CONTRACTOR SHALL OBTAIN WRITTEN APPROVAL FROM THE CITY ENGINEER FOR ANY OTHER CONFIGURATION.

1

NO.	REVISION	DATE	STANDARD DETAIL FOR PUBLIC WORKS CONSTRUCTION	SECTION
1	NOTE 2	10/25	<b>WATER AND SEWER SEPARATION GUIDELINES</b>	CARSON CITY
				DRAWING NO. C-3.1.2
				DATE OCT 2025
APPROVED BY: <u>DA</u>		10/25		